


Canada's Tournament Capital

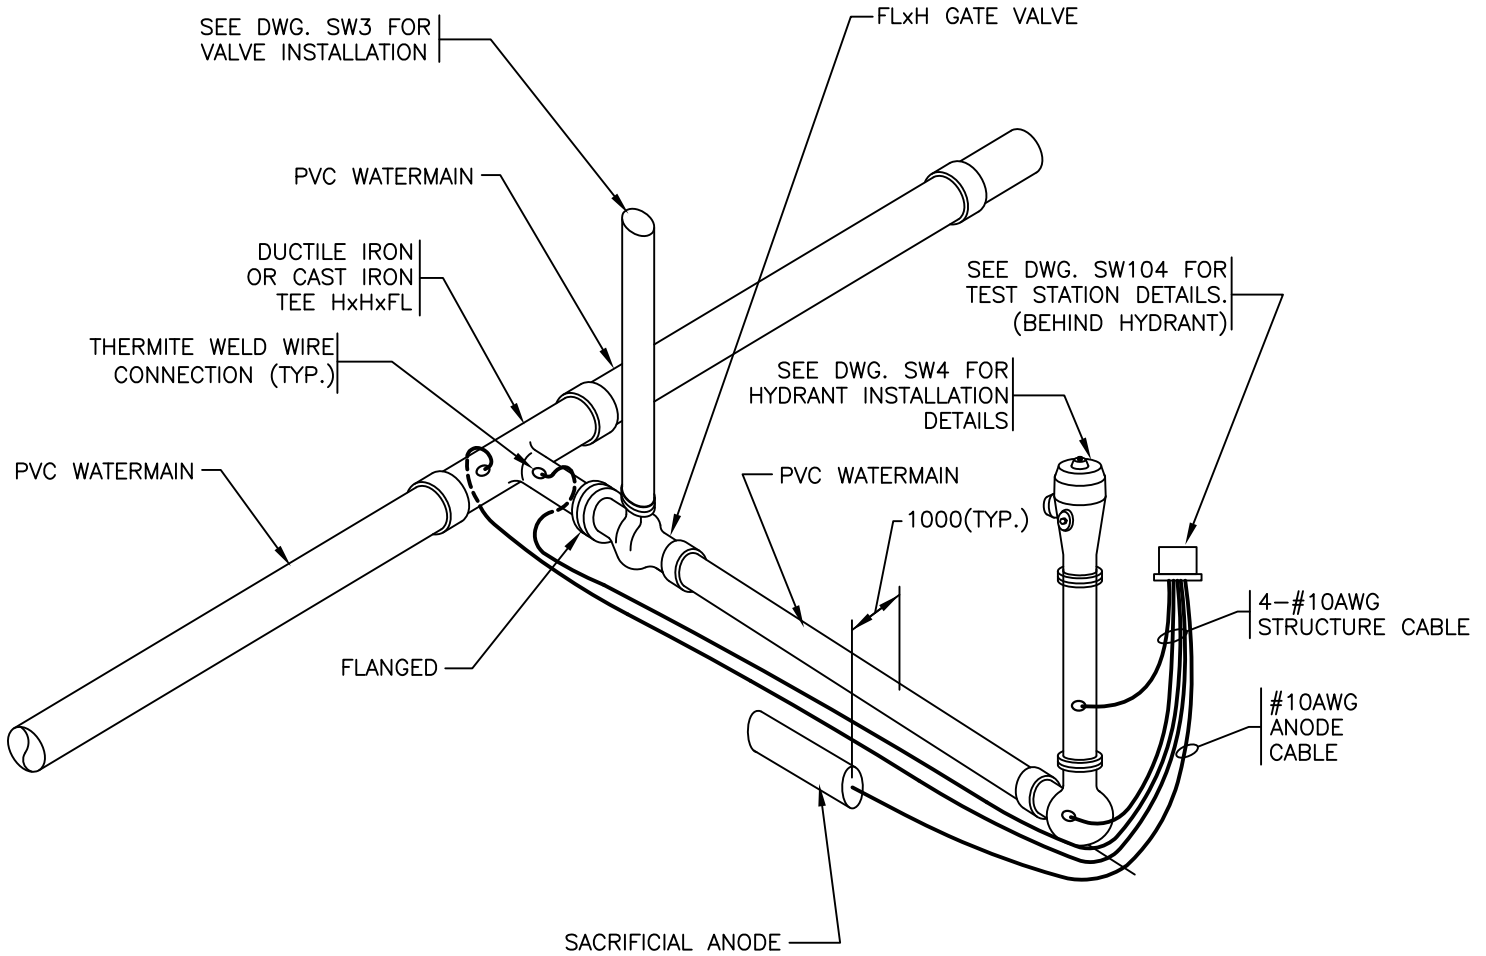

NOTES:

1. CONFIRM ELECTRICAL CONTINUITY BETWEEN TEE AND GATE VALVE. INSTALL DOUBLE BONDS IF NOT ELECTRICALLY CONTINUOUS.
2. CONFIRM HIRE HYDRANT RISER AND 90° BEND ARE ELECTRICALLY CONTINUOUS. INSTALL DOUBLE BONDS IF NOT CONTINUOUS.
3. STRUCTURE CABLES TO BE WRAPPED ONCE AROUND TEE AND GATE VALVE.
4. ATTACH ALL CABLES TO PIPE USING PIPELINE TAPE.
5. INSTALL ANODE(S) IN LOCATIONS SPECIFIED IN CONTRACT AND PARALLEL TO PIPE.
6. INSTALL TEST STATION BEHIND HYDRANT.

**FIRE HYDRANT
INSTALLATION
FOR PVC PIPE**

CITY OF KAMLOOPS

NO.	DATE	REVISION	DESCRIPTION	BY	APP

DWN. BY: DAR

CHK'D BY:GC

SCALE: N.T.S.

DATE: 11/FEB/25

DWG. NO.: **SW119**

REV.: